Details Provided by APPIAN Consulting Engineers – www.appianengineers.com

PART	MANUFACTURER MODEL / Cat. No.
COMBO A.R. & VACUUM VALVE	A.R.I. D025-ST02 SS/FLANGED

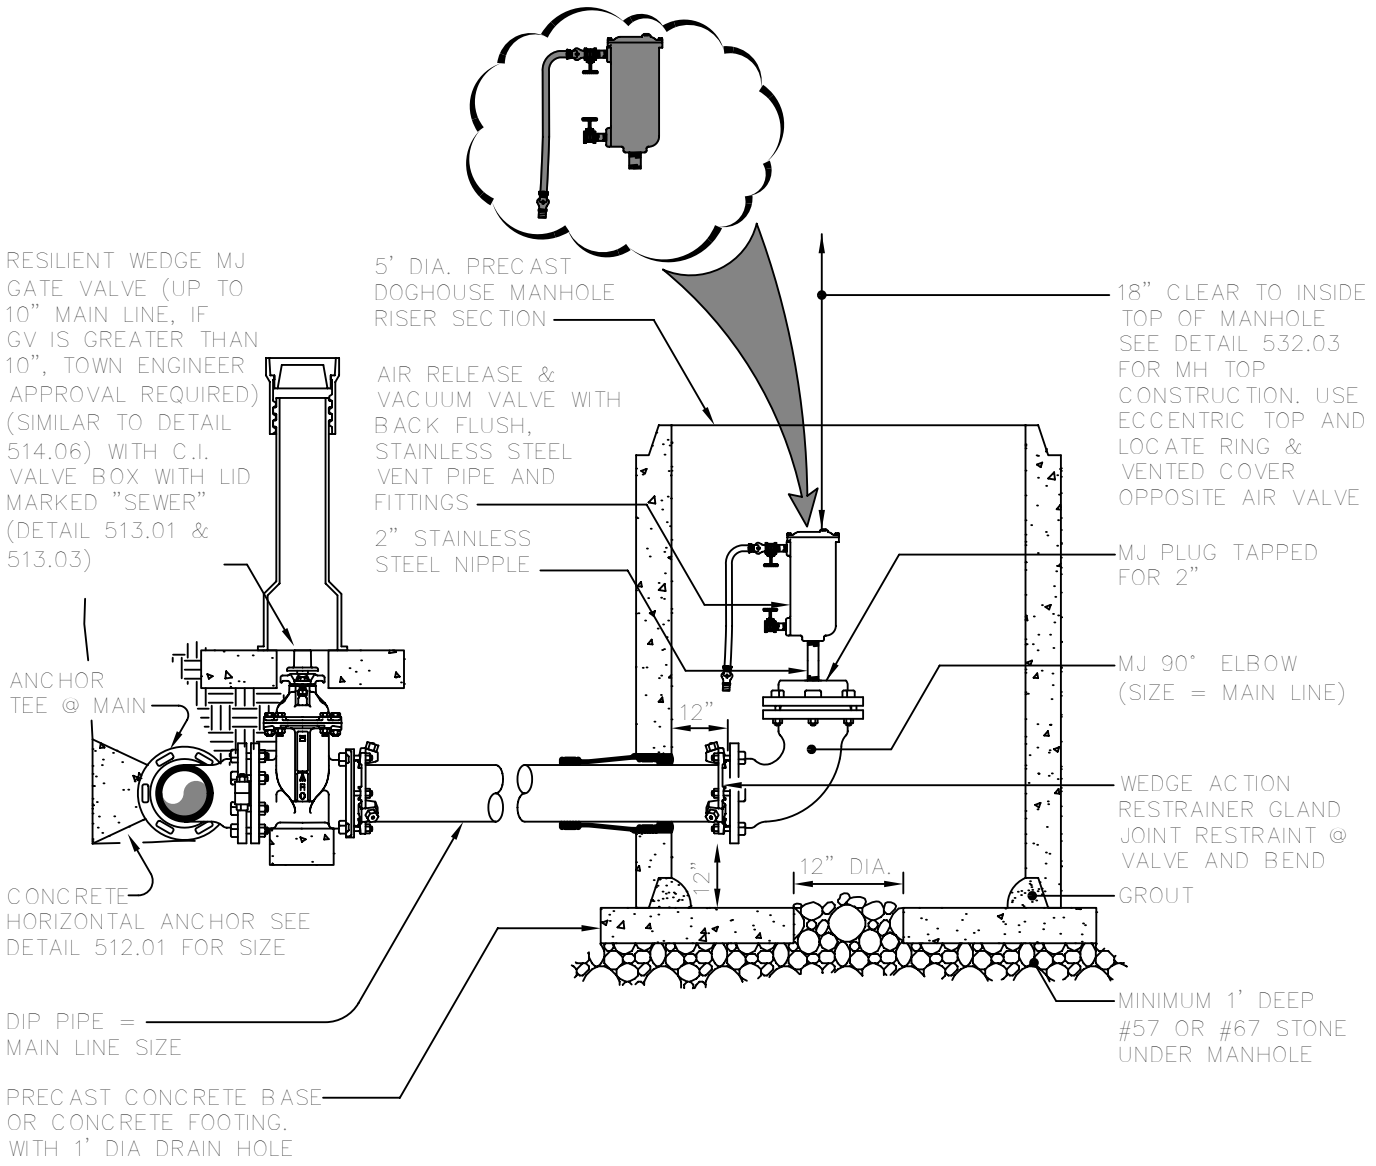

NOTES:

1. Provide a minimum of 3'-6" cover over sewer line.
2. All pipe fittings to be stainless steel.
3. Ensure 12" minimum clearance between manhole wall and floor to MJ elbow.
4. Ensure 18" minimum clearance between manhole top to air valve.
5. Manhole penetration to be precast or cored and booted.

TOWN of CLAYTON

USE WITH THE TOWN of CLAYTON STANDARD SPECIFICATIONS ONLY

FORCE MAIN AIR / PRESSURE RELEASE VALVE IN MANHOLE

SCALE:	DETAIL #
Not To Scale	534.06
REVISION DATE: APRIL, 2014	SHEET #: 1 of 1